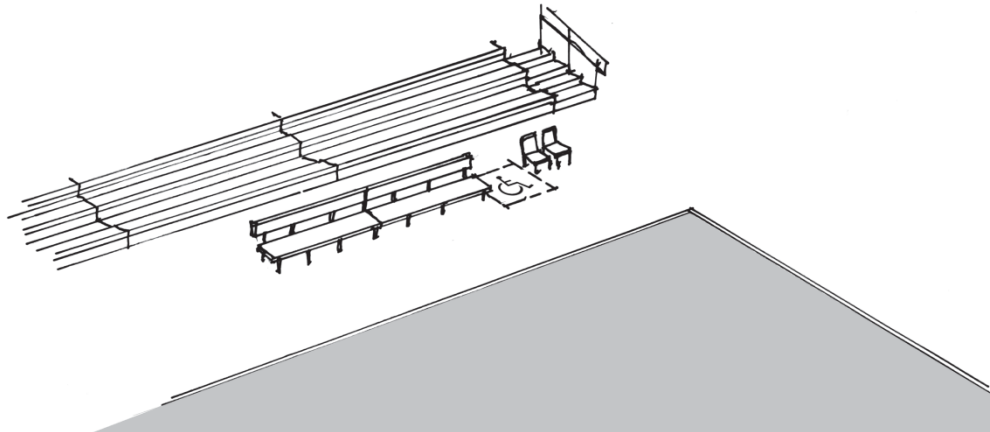

ADA Checklist for Existing Facilities

Sports Activities, Team or Player Seating, Exercise Machines & Equipment, Bowling Lanes, Saunas & Steam Rooms and Shooting Facilities



Project _____

Building _____

Location _____

Date _____

Surveyors _____

Contact Information _____



Institute for Human Centered Design

www.HumanCenteredDesign.org

2014



ADA National Network




Questions on the ADA 800-949-4232 voice/tty

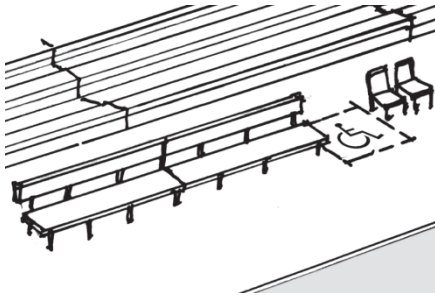

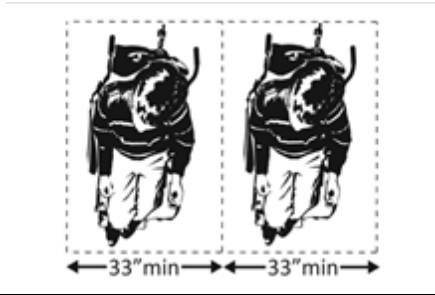
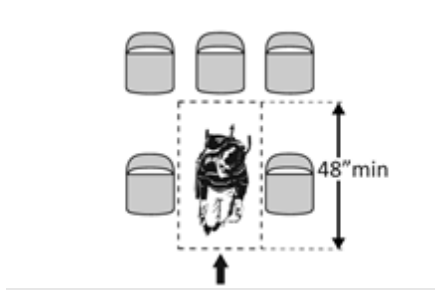
www.ADAchecklist.org


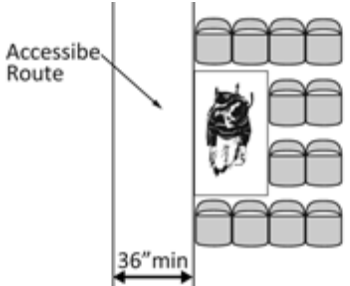
This checklist was produced by the New England ADA Center, a project of the Institute for Human Centered Design and a member of the ADA National Network. This checklist was developed under a grant from the Department of Education, NIDRR grant number H133A060092-09A. However the contents do not necessarily represent the policy of the Department of Education, and you should not assume endorsement by the Federal Government.

Questions or comments on the checklist contact the New England ADA Center at 617-695-0085 voice/tty or ADAinfo@NewEnglandADA.org

For the full set of checklists, including the checklists for recreation facilities visit www.ADAchecklist.org.

Misc. Recreation		Comments	Possible Solutions
Sports Activities (2010 Standards – 206 & Ch. 4) Soccer fields, basketball courts, tennis courts, baseball fields, running tracks, skating rinks, etc.			
<p>S1 Is there an accessible route to each type of sport activity?</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>For exterior routes use the checklist for <i>Priority 1: Approach & Entrance</i>.</p> <p>For interior routes use the checklist for <i>Priority 2: Access to Goods & Services</i>.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> 	<p>Photo #:</p>	<ul style="list-style-type: none"> • Add a ramp • Regrade to 1:20 maximum slope • Widen route • Change route surface • Add a platform lift, limited use/ limited application elevator or a regular elevator
<p>S2 At court sports (tennis, basketball, volleyball, etc.) does at least one accessible route connect both sides of the court?</p> <p>Note: This is particularly important in sports such as tennis, where changing sides is part of the game.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> 	<p>Photo #:</p>	<ul style="list-style-type: none"> • Add a ramp • Regrade to 1:20 maximum slope • Widen route • Change route surface
Team or Player Seating (2010 Standards – 206, 221 & 802) Baseball, hockey, basketball, football, etc.			
<p>T1 At areas of sport activity, is there an accessible route to each side of team or player seating?</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>For exterior routes use the checklist for <i>Priority 1: Approach & Entrance</i>.</p> <p>For interior routes use the checklist for <i>Priority 2: Access to</i></p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> 	<p>Photo #:</p>	<ul style="list-style-type: none"> • Add a ramp • Regrade to 1:20 maximum slope • Widen route • Change route surface • Add a platform lift

<i>Goods & Services.</i>			Photo #:	
T2	Is there at least one wheelchair space at team or player seating areas?	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:	 A perspective diagram showing a row of bleachers. A wheelchair is positioned in a designated space between two rows of seats, marked with a wheelchair symbol on the floor.	Photo #: • Add wheelchair space • •
T3	If there is a single wheelchair space, is it at least 36 inches wide?	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:	 A top-down diagram of a wheelchair. A dashed rectangular box surrounds the wheelchair, with a double-headed arrow below it indicating a width of "36" min".	Photo #: • Alter space • •
T4	If there are 2 adjacent wheelchair spaces, are they each at least 33 inches wide?	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:	 A top-down diagram showing two wheelchairs side-by-side. Dashed rectangular boxes surround each wheelchair, with double-headed arrows below each box indicating a width of "33" min".	Photo #: • Alter spaces • •
T5	If the wheelchair space can be entered from the front or rear, is it at least 48 inches deep?	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:	 A top-down diagram showing a wheelchair in a space between two rows of seats. A dashed rectangular box surrounds the wheelchair, with a double-headed arrow to its right indicating a depth of "48" min". An arrow points upwards from the bottom of the box, indicating the entry direction.	Photo #: • Alter space • •

<p>T6 If the wheelchair space can only be entered from the side, is it at least 60 inches deep?</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Alter space • •
<p>T7 Do wheelchair spaces adjoin, but not overlap, accessible routes?</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Alter spaces • •
<p>T8 Do wheelchair spaces not overlap circulation paths?</p> <p>Note: The term "circulation paths" means aisle width required by applicable building or life safety codes for the specific assembly occupancy. Where the circulation path provided is wider than the required aisle width, the wheelchair space may intrude into that portion of the circulation path that is provided in excess of the required aisle width.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Alter spaces • •

Exercise Machines & Equipment (2010 Standards – 206, 236 & 1004)

E1 Is there an accessible route to at least one of each type of exercise machine and equipment?

Yes No

Use the checklist for Priority 2: Access to Goods & Services

Note: Most strength training equipment and machines are considered different types. For example, a bench press machine is different from a biceps curl machine. Cardiovascular exercise machines, such as stationary bicycles, rowing machines, stair climbers and treadmills, are all different types.



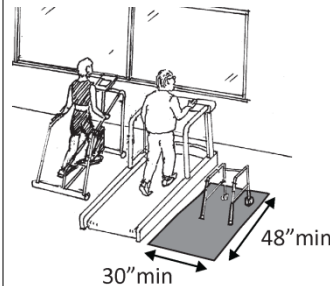
Photo #:

- Add a ramp
- Regrade to 1:20 maximum slope
- Widen route
- Change route surface
- Add a platform lift, limited use/ limited application elevator or a regular elevator

E2 Is there clear floor space at least 30 inches wide by at least 48 inches long positioned for transfer or for use by a person seated in a wheelchair next to at least one of each type of exercise machine and equipment?

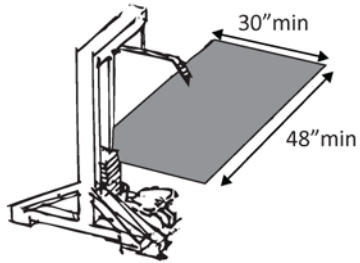
Yes No

Measurement:

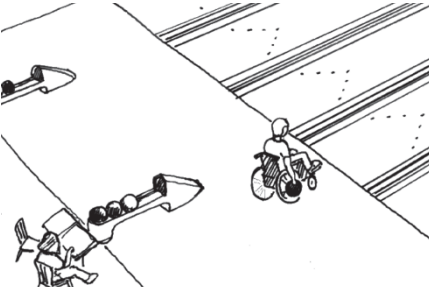


Notes:
1. To make a shoulder press accessible, the clear floor space should be next to the seat. For a bench press, the clear floor space should be centered on the operating mechanisms.


- Add clear floor space
-
-

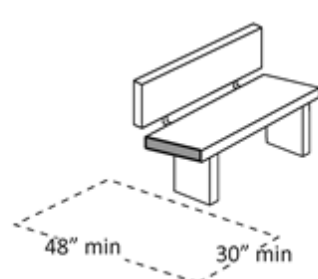


<p>2. Machines and equipment can share clear floor space.</p> <p>3. The exercise equipment and machines do not need to comply with the 2010 Standards specifications for controls and operating mechanism.</p>			<p>Photo #:</p>	
--	--	--	-----------------	--

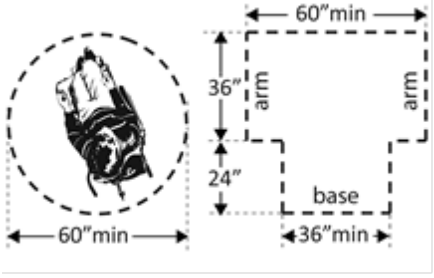

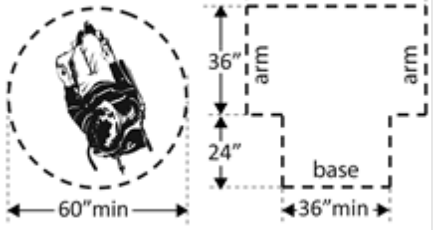
Bowling Lanes (2010 Standards – 206 & Ch.4)

<p>B1 Is there an accessible route to at least 5 percent but no less than one of each type of bowling lane?</p> <p>For interior routes use the checklist for <i>Priority 2: Access to Goods & Services</i>.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Number:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Add a ramp • Regrade to 1:20 maximum slope • Widen route • Change route surface • Add a platform lift
--	--	--	-----------------	---

Saunas & Steam Rooms (2010 Standards – 241 & 612)

<p>S1 Is there an accessible route to at least one sauna and steam room?</p> <p>If there are separate rooms for men and women, is there an accessible route to at least one for each gender?</p> <p>For interior routes use the checklist for <i>Priority 2: Access to Goods & Services</i>.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Add a ramp • Regrade to 1:20 maximum slope • Widen route • Change route surface • Add a platform lift, limited use/ limited application elevator or a regular elevator
---	---	--	-----------------	--

<p>S2 If there is seating in the room does at least one bench:</p> <p>Have clear floor space at least 30 wide inches by at least 48 inches long at the end of the bench and parallel to the short axis of the bench?</p> <p>Is the clear space free from the swing of the room door?</p> <p>Is the bench seat: At least 42 inches long?</p> <p>No less than 20 inches and no greater than 24 inches deep?</p> <p>Is the top of the bench seat no less than 17 inches and no greater than 19 inches above the floor or ground?</p> <p>Does the bench have back support or is it affixed to a wall?</p> <p>Does the back extend from a point no more than 2 inches and a point no less than 18 inches above the seat surface?</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>	  	<p>Photo #:</p>	<ul style="list-style-type: none"> • Move bench • Replace bench • Affix bench to wall • •
--	---	--	-----------------	--

<p>S3 Is there a clear floor space for a person in wheelchair to turn around in the room, i.e. a circle at least 60 inches in diameter or a T-shaped space within a 60-inch square?</p> <p>Note: A readily removable bench is permitted to obstruct the turning space.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Add space • Move or remove partitions, fixtures or objects •
<p>Shooting Facilities with Firing Positions (2010 Standards – 243 & 1010)</p>				
<p>S1 Is there an accessible route to the shooting facility?</p> <p>For exterior routes use the checklist for <i>Priority: 1 Approach & Entrance</i>.</p> <p>For interior routes use the checklist for <i>Priority 2: Access to Goods & Services</i>.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Add a ramp • Regrade to 1:20 maximum slope • Widen route • Change route surface • Add a platform lift, limited use/ limited application elevator or a regular elevator
<p>S2 Is there a clear floor space for a person in wheelchair to turn around, i.e. a circle at least 60 inches in diameter, for at least 1 of each type of firing position?</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Add space • Move or remove partitions, fixtures or objects •